

THE EFFECT OF FORECASTING ACCURACY ON THE SIZING OF ENERGY STORAGE

Christina Jaworsky *

Department of Mechanical Engineering
Massachusetts Institute of Technology
Cambridge, Massachusetts 02139
Email: jaworsky@mit.edu

Konstantin Turitsyn

Department of Mechanical Engineering
Massachusetts Institute of Technology
Cambridge, Massachusetts 02139
Email: turitsyn@mit.edu

Scott Backhaus

Center for Nonlinear Studies
Los Alamos National Laboratory
Los Alamos, New Mexico 87545

ABSTRACT

The purpose of this research is to the problem of optimal sizing of energy storage required for compensation of wind farm generation variability. Using wind farm production data from the BPA, we assess the effect of forecast quality and economic dispatch timing on the size of storage and critical power rating required to nearly perfectly match the committed energy. We develop a Model-Predictive-Control (MPC) based operational model following NERC standard recommendations. Different forecasts are considered and compared from the storage sizing perspective. The results of our simulations can be fit by two simple relations, connecting the storage sizing with forecast error, wind variability, and the timescales of scheduling. A more accurate forecast reduces the storage sizing. However, diminishing returns are observed when the forecast error becomes comparable to natural wind variability within the commitment time interval. The proposed methodology can be extended to other systems with intermittent generation and controllable real or virtual storage.

NOMENCLATURE

t_C	Length of commitment interval
t_{LA}	Look ahead time for advance scheduling
t_D	Delivery time interval
T_h	Forecast horizon
P_{set}	Scheduled power

P_{del}	Delivered power
P_l	Lost/curtailed power
P_c	Power used to charge storage
P_d	Power discharged from storage
P_w	Power available from wind
η	Single trip efficiency of storage
P_{cap}	Power capacity of storage
E_{cap}	Energy capacity of storage
σ_{err}	Average forecast error
σ_{wind}	Wind power standard deviation during commitment intervals
σ_{tot}	Total error
P_{RMS}	RMS of the mismatch between delivered and scheduled power

The spacing between abstract and the text heading is two line spaces. The primary text heading is boldface in all capitals, flushed left with the left margin. The spacing between the text and the heading is also two line spaces.

INTRODUCTION

Renewable generation offers a clean and sustainable alternative to fossil fuel generation. The level of penetration of renewable resources, especially wind, is expected to reach the figure of 20% in the coming two decades [1, 2]. This transition poses a tremendous challenge to modern power systems that rely on fully dispatchable generation resources. Future power sys-

*Address all correspondence to this author.

tems will have to operate in the presence of forecast uncertainty and therefore significant amounts of backup generation or large amounts of electric storage would be required for short term and midterm balancing needs. Rapid advancements in electricity storage technologies make them especially attractive for wind integration [3–5]. One particular question that must be answered in any feasibility assessment is the optimal sizing of storage necessary to alleviate the intermittency problems of utilizing renewable resources. This is an unexpectedly difficult question as the answer depends on many parameters. These include, but are not limited to, the technological properties of storage equipment, the statistical characteristics of a renewable generator's production, and the quality of the forecast available to system operators. In this paper we attempt to address some of these questions, focusing mostly on the least understood question of the value of forecast quality.

Analysis and synthesis of optimal operation schemes is not possible without inputs from atmospheric sciences, statistical forecasting, power systems operation and regulation, and electric storage engineering. One of the first optimal energy storage dispatch algorithms for short term markets with heavy wind generation penetration was introduced in [6]. Stochastic security framework for operational planning was proposed in [7], allowing for better efficiency in comparison to more conservative, worst-case scenario approaches. A more sophisticated method of energy storage, where the probability distribution of storage requirements was found for a set of scenario forecasts, accounts for the uncertainty of the wind was presented in [8]. It was shown that storage can effectively operate as a separate market entity by hedging against wind power forecast errors and by dynamically sizing storage to increase the efficiency of the system without affecting the producer's profit. Another study, looking at the time to saturation of a storage device's state of charge given different forecasts, [9] has shown that although large amounts of storage are required to completely compensate for the wind forecast errors, an allowance for small amounts of unserved energy dramatically reduces the storage size requirements.

In this paper, analyze the effect of forecast quality on the storage capacity necessary to suppress the variability of intermittent wind generation. We consider a mid-timescale service where the energy storage is used to enable a wind farm or an aggregation of farms to maintain a scheduled hourly output after economic dispatch. We use a model that mimics the INT-006-3 request for interchange standard proposed by NERC [10]. Within these guidelines, energy from large generators is typically scheduled in hourly blocks where generators are expected to maintain a relatively uniform power output. To allow time for data collection, optimal scheduling, and generator ramping from one hourly setpoint to the next, generator output for an hour is typically scheduled 90 minutes before its start. The timeline for this process is shown in Fig. 1 and explained in detail in section . This timeline dictates that for energy storage operation coor-

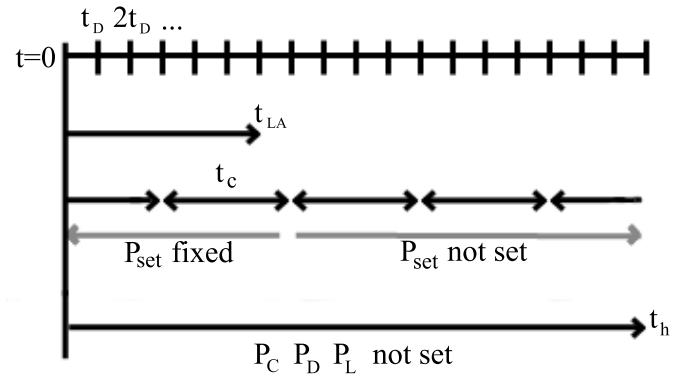


FIGURE 1. TIMELINE OF THE SEQUENCE AND TIME LAGS BETWEEN THE SCHEDULING THE INTERCHANGE USED IN OUR MODEL OF A GENERATOR CONNECTED TO THE BULK POWER SYSTEM.

ordinated with wind generation, the crucial period for forecasting is 90-150 minutes into the future. However, the time-integral constraint imposed by the finite energy storage capacity, E_{cap} , implies that forecasting is also important at shorter and longer timescales, i.e. it may be beneficial to save capacity for variability forecasted in the more distant future.

The time-integral constraint and the incorporation of forecasting are addressed by model predictive control (MPC) of energy storage. Using a convex optimization package, we control the storage device in a way that minimizes the deviation of set power from delivered power over the forecast horizon at each time step. This means an optimization is performed at each time step, however the control method finds the best possible set of actions given the forecast. We incorporate large historical wind generation datasets [11] into extensive simulations of the MPC of energy storage, finding how the residual deviations from the scheduled interchange scale with the storage capacity E_{cap} , the maximum charge/discharge rates P_{cap} , and the standard deviation of the forecast errors σ_{err} . The results can be interpreted as rules for using the statistics of historical wind generation and errors in forecasting to appropriately size E_{cap} and P_{cap} of a jointly operated energy storage and generation system. By using the hybrid data-driven Monte-Carlo based simulations as an experimental tool, we assess the dependence of the necessary storage capacity and power rating on other system parameters like forecast error and commitment/look-ahead time.

The structure of this paper is as follows: In Model, we describe the market, storage, and MPC control and forecast models used in our study. The results of our simulations and their interpretation are presented in Simulation. Analysis and our final predictions are described in Analysis, and our conclusions and future plans are included in the last section, Conclusion.

Model

Market Structure

Wind generators will have to participate in the electricity market to be economically viable. This means that wind generation must be scheduled ahead of time, and a constant power output must be maintained over a production interval. Although wind is intermittent and uncontrollable, with some amount of storage, it is possible to compensate for errors between the actual wind generation and committed power output.

Economic dispatch of electricity generation requires planning traditional fossil fuel and nuclear generators to start up, shutdown, and ramp between set points. Generators must make bids to be scheduled ahead of when they are committed to operate. In our model, we account for scheduling of future generation by introducing a look ahead time, t_{LA} . At all times up to t_{LA} , the generator's power output has already been scheduled in previous economic dispatch. The generator is scheduled to have constant output, P_{set} , on commitment intervals of length t_C . The production during these intervals is scheduled when the start of the interval is t_{LA} ahead of the current time. The set power of future t_C intervals can always be changed until their start time reaches t_{LA} , at which point it is scheduled. Power is delivered within each commitment interval on a shorter time scale, called the delivery time, t_D . A generator is penalized on each delivery interval for the deviation from the actual delivered power, P_{del} , from the scheduled power, P_{set} . This means that for an intermittent resource like wind to be a competitor in the electricity market, it must either not use all available generation and curtail wind or incorporate some kind of storage or fast ramping gas generator to correct for imperfect scheduling and wind variability during delivery intervals.

In our simulations, we tested look ahead times of $t_{LA} = 30, 60$ and 90 minutes. Commitment times were set to $t_C = 15, 30, 45$ and 60 minutes. Deliveries were always made on 15 minute intervals of $t_D = 15$ minutes. The time horizon, T_h , on which a forecast of future generation was available, was set to 270 minutes from the current time. Other time horizons were considered but did not affect the results.

Wind Generation and Storage

We consider a simple model of a wind farm and ESS. Our model captures the main statistical characteristics of the wind and technological constraints associated with the storage. We aggregate all wind generation into a single source, and we aggregate all ESS as a single storage device connected to the grid. ESS can either be located on the site of the wind generation or connected elsewhere. However, because we do not model transmission losses or congestion, our model only applies to cases where transmission to the storage devices is not constrained by the grid. We allow exchange of power between the renewable generator, storage device, and external grid. The details of the

interconnections are not modeled. We assume that the energy captured from the wind can be transferred either directly to the external grid or routed to the storage system and transferred to the grid at later times. To describe power flow and energy state in the storage device, we use the following set of equations with discrete time steps of t_D :

$$P_{del}(t) = P_w(t) + \eta P_d(t) - P_c(t) - P_l(t) \quad (1)$$

$$E(t + \Delta T) = E(t) + \eta P_c(t) \Delta T - P_d(t) \Delta T \quad (2)$$

where, $P_{del}(t)$ represents the average power delivered to the grid during the time interval ΔT , and $P_w(t)$ is the power delivered from the wind farm. The process of storage charging is represented by the average charging and discharging rates, $P_c(t)$ and $P_d(t)$. The single trip efficiency is represented by coefficient η , set to .8 for this study. We ignore the self-discharge rate, assuming that the energy lost to self-discharge is small relative to the total amount of energy flowing through our system. Finally, we account for the effect of wind curtailment in the system with the variable $P_l(t)$. Curtailment can happen either at the wind turbine control level or at the point of interconnection of our aggregate system with the external grid.

We used the BPA wind generation time series [11] to simulate one week of wind generation. The capacity of the wind generation in the BPA system increased over time, so separate simulations were performed for the years 2007-2011. Within this timeframe, the total installed wind capacity increased from 700 to 3500 MW. The weeks used in the simulations were chosen from different months to prevent any kind of seasonal bias.

Optimization and MPC of storage

Our model uses MPC to optimize the storage control, wind curtailment, and generation scheduling. The MPC is run on every time step and looks ahead over T_h . On the interval $t' \in [t, t + T_h]$, all the values $P_d(t')$, $P_c(t')$ and $P_l(t')$ are available for optimization. However, only $P_{set}(t')$ for commitment intervals that start after the look-ahead time, $t' > t + t_{LA}$ can be controlled. This means the MPC uses storage and curtailment to adhere to the previously set schedule to the best of its ability and chooses a future P_{set} schedule based on the forecast. Typically, the MPC chooses future P_{set} to be close to the mean of predicted wind generation during the corresponding commitment time interval. For each time step, the MPC attempts to minimize the squared deviation of the mismatch between the committed and actually delivered power, $(P_{del} - P_{set})^2$, for each delivery time interval seen in the control horizon.

In our model, storage technology and the interconnection properties are incorporated via constraints. The constraint E_{cap} restricts the total amount of energy that can be stored in the storage system at any moment of time: $0 \leq E(t) \leq E_{cap}$, given by Eqn.(6). Next, we limit the charge and discharge rate of storage. In real systems, this constraint can either represent the power rating of the storage system or the transmission limits of the interconnection system: $0 \leq P_c(t), P_d(t) \leq P_{cap}$, Eqn. (7). We assume that no power can be drawn from the grid, which is accounted for with the inequalities $P_{del}(t), P_l(t) \geq 0$, Eqn. (8). We have also constrained the overall levels of system efficiency, $\sum_{t=1}^T (P_l(t) + \eta P_c(t) + \eta P_d(t)) \leq 0.01 \sum_{t=1}^T P_w(t)$, Eqn. (9), meaning 99% of the energy available from the wind must eventually be delivered to the grid. The overall system efficiency ensures that the wind turbine system produces power, preventing trivial solutions where huge amounts of power are curtailed.

The above discussion can be summarized in the following optimization problem:

$$\min_{P_c, P_d, P_l, P_{set}, P_{del}} \sum_{t=1}^{T_h} (P_{del}(t) - P_{set}(t))^2 \quad (3)$$

subject to :

$$P_{del}(t) = P_w(t) + \eta P_d(t) - P_c(t) - P_l(t), \quad (4)$$

$$E(t + \Delta T) = E(t) + \eta P_c(t) \Delta T - P_d(t) \Delta T, \quad (5)$$

$$0 \leq E(t) \leq E_{cap}, \quad (6)$$

$$0 \leq P_c(t), P_d(t) \leq P_{cap}, \quad (7)$$

$$P_g(t), P_l(t) \geq 0 \quad (8)$$

$$\sum_{t=1}^T (P_l(t) + \eta P_c(t) + \eta P_d(t)) \leq 0.01 \sum_{t=1}^T P_w(t) \quad (9)$$

The optimization is performed with respect to the values $P_c(t'), P_d(t'), P_l(t')$ on the interval $t' \in [t, t + T_h]$ and with respect to the values of $P_{set}(t')$ on the interval $t' \in [t + t_{LA}, t + T_h]$.

Forecast Models

In the absence of real forecast data, we use two artificial forecast models in our studies. The forecast of the wind is updated at each time step according to one of the following procedures:

Forecast A: Gaussian. In the first model of forecast, we add Gaussian noise $\xi(t')$ to the wind time series to forecast of future generation, $\tilde{P}_w(t') = P_w(t') + \xi(t')$, where $t' \in [t, t + T_h]$. The values of the noise are statistically independent at every moment of time and their mean value is zero, $\langle \xi(t') \rangle = 0$. The variance of the noise scales over the forecast horizon to represent more uncertainty in future events. To compare forecasts of different qualities, we introduce the standard deviation of the fore-

cast error, σ_{err} . We calculate σ_{err} by averaging the error over the interval $[t + t_{LA}, t + t_{LA} + t_C]$, the time interval where P_{set} was chosen. The Gaussian forecast models the persistence and changes in wind generation and mimics the high-quality forecasts available from meteorological measurements.

Forecast B: Persistence. The second forecast model simulated is a persistence model. Two variations are considered: one where the wind maintains the same average output as the previous hour and one where it follows a linear fit of the previous hour's generation. The persistence model is not as realistic as the Gaussian model because it does not take into consideration the availability of meteorological measurements and weather models that forecast wind power production. The persistence model causes gross over and underestimation of the available wind power over the forecast horizon. Storage requirements for persistence forecasting are more than an order of magnitude greater than for the Gaussian forecasting. Therefore, a forecast that has information about future wind events permits a smaller and less expensive storage device.

Simulation Results

The performance of our generation and storage model was measured by considering the RMS error of the scheduled and delivered power mismatch:

$$P_{RMS} = \sqrt{\frac{1}{T} \sum_{t=1}^T [P_{del}(t) - P_{set}(t)]^2} \quad (10)$$

where, T is one week for each data set. We have primarily focused on assessing how the RMS error depends on the quality of a forecast and the capacity and charging rate of a storage system.

Forecast Techniques

Persistence forecasts underperformed. Unless we considered unrealistically large storage capacities, the RMS error was substantial. Simulations showed that the P_{set} scheduled were different from the actual behavior of the wind, and the ESS was unable to compensate for the errors in prediction. The persistence forecasts did not use any information about the future wind behavior, and, as a result, the forecast made at t_{LA} minutes in the forecast horizon inaccurately represented the actual wind.

Forecasts with a Gaussian error yielded better results, and all further analysis is derived from this forecast model. Energy capacities equivalent to storing a few minutes of maximum wind farm generation were shown to reduce the RMS error substantially, seen in Fig. 2. Forecast A was able to forecast the shape of the future wind profile, correctly predicting the important events and changes in wind generation over the forecast horizon. The

Gaussian forecast was not misrepresenting the behavior of the wind at the moment critical for scheduling, $t + t_{LA}$. Because there was a accurate representation of the wind behavior, the optimal P_{set} found was close to what the actual realization of the wind was.

Identifying Critical Values of Parameters

To size storage, we plot the storage property against its RMS performance. We observed a trend of a steep decrease of error followed by constant error, shown in Fig. 2 for storage capacity and Fig. 3 for power rating. This indicated that there was a critical value of storage capacity, E_{cap}^* , and power rating, P_{cap}^* , beyond which there was no performance increase with larger storage properties. At this critical point, the storage system had the minimal values of its properties, where the error is nearly removed, therefore E_{cap}^* and P_{cap}^* were the cheapest storage option. While there is no harm in oversizing storage, it adds to the expense of using renewable generation.

Wind Variability versus Energy Capacity

In the first series of experiments, we simulate the operation of storage without any constraints on the power rating, $P_{cap} \rightarrow \infty$. We set $t_C = 1$ hour and $t_{LA} = 90$ minutes. For each dataset, we find the $E_{cap}^*(\sigma)$ required to drive P_{RMS} to its asymptotic value. The value of E_{cap}^* depends on the deviations of the wind from the scheduled power, P_{set} . The deviations occur both from the natural variability of the wind within the commitment interval, σ_{wind} , and the error in the forecast, σ_{err} .

In our simulations of datasets from different years, we observe a wide range of natural wind variability. We scale the forecast error with the total capacity of the wind generation. Fig. 4 shows the correlation between the required storage capacity and the total variability in the wind. E_{cap}^* can be approximated by the following expression:

$$E_{cap}^* = \tau_{wind} \sqrt{\sigma_{wind}^2 + \sigma_{err}^2} \quad (11)$$

where, τ_{wind} was found to be $\tau_{wind} \approx 1.6$ hours for the one hour commitment time interval. With no forecast error, $P_{set}(t)$ is perfectly scheduled, and the storage only mitigates the natural variability of the wind generation with commitment intervals, characterized by the standard deviation, σ_{wind} . When forecast error is introduced to the model, storage must also compensate for incorrect predictions of the scheduled power. The inclusion of forecasting error changes the total deviation of the wind to

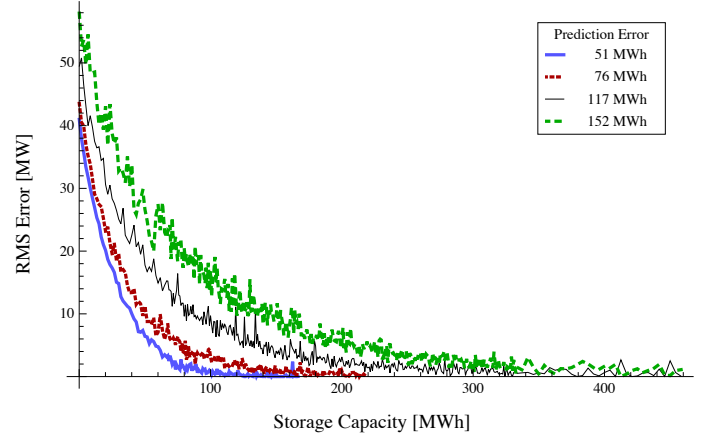
$$\sigma_{tot} = \sqrt{\sigma_{wind}^2 + \sigma_{err}^2}.$$


FIGURE 2. POWER FLUCTUATIONS, AS MEASURED BY P_{RMS} , VERSUS THE E_{CAP} FOR AN UNCONSTRAINED P_{CAP} FOR A RANGE OF FORECAST ERRORS σ_{ERR} . CRITICAL STORAGE CAPACITY E_{CAP}^* IS THE VALUE OF ENERGY CAPACITY WHERE P_{RMS} REACHES ITS ASYMPTOTIC VALUE.

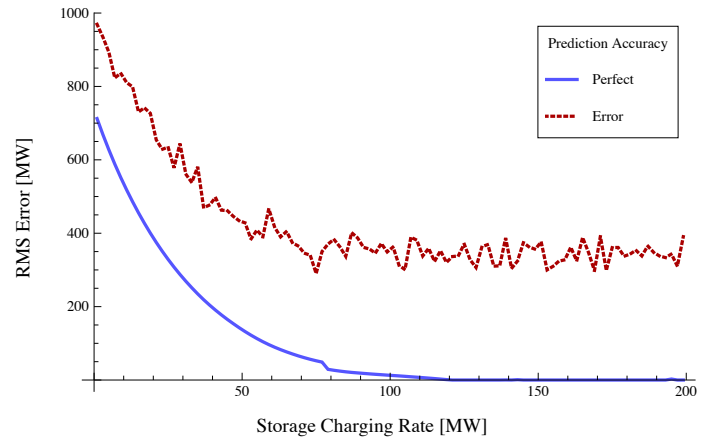


FIGURE 3. P_{RMS} VERSUS P_{CAP} FOR PERFECT (DASHED) AND IMPERFECT (SOLID) FORECASTING. EACH PLATEAUS TO A CONSTANT VALUE AT THE SAME POWER RATING. IN THESE SIMULATIONS, THE STORAGE ENERGY CAPACITY WAS SET AT $E_{CAP}^*(\sigma_{ERR})$. NOTE THAT THE SATURATION OF THE PERFECT FORECAST PLOT HAPPENS AT EXTREMELY LOW P_{RMS} VALUES.

Commitment Time versus Energy Capacity

To understand how the storage requirements were affected by the scheduling timescales, we ran simulations with different commitment intervals t_C from 15 to 60 minutes. For consistency, we kept t_{LA} at 90 minutes and t_D at 15 minutes. Longer time commitment intervals required more storage for the same amount of

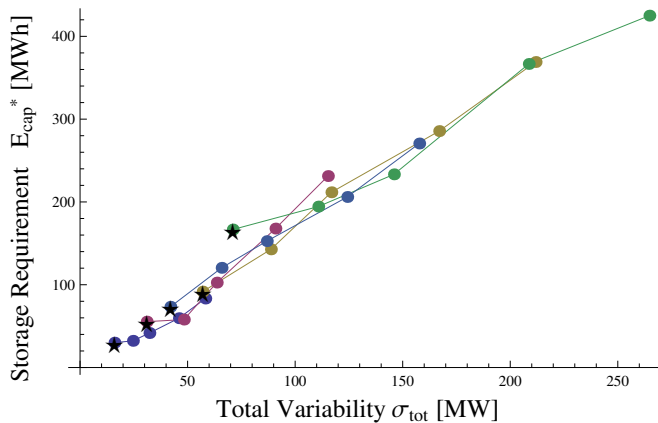


FIGURE 4. THE REQUIRED STORAGE CAPACITY IS DIRECTLY PROPORTIONAL TO THE TOTAL AMOUNT DEVIATION OF THE WIND. EACH COLOR REPRESENTS A DIFFERENT YEAR OF DATA. THE STARRED DATA POINTS SHOW THE CASES WHERE THERE IS A PERFECT FORECAST AND ONLY NATURAL WIND VARIABILITY σ_{WIND} AFFECTS THE REQUIRED STORAGE CAPACITY.

total variability because the scheduled power had to be maintained at a constant value for a longer time period. We found that the value of τ_{wind} , the slope in Eqn. (11), scales linearly with t_C . In Fig. 5 we show the dependence of E_{cap}^* on σ_{tot} and t_C . For each t_C , a different slope relating how critical storage capacity E_{cap}^* scaled with total error σ_{tot} was found. The required storage capacity scales linearly with the length of t_C . Based on these observations, the following formula is proposed relating the capacity, variability and commitment time:

$$E_{cap}^* = 1.6t_C \sqrt{\sigma_{wind}^2 + \sigma_{err}^2}, \quad (12)$$

The coefficient 1.6 might be related to the properties of Gaussian noise because it is proportional to exactly twice the average expected absolute deviation from the mean for Gaussian noise. Although we don't have a model supporting this conjecture, it might be worthwhile to check if this observation holds for other statistical forecast error models.

Storage Capacity versus Look Ahead Time

Next, we tested how the look ahead time t_{LA} affects the critical amount of storage E_{cap}^* required to suppress the power output fluctuations. We tested t_{LA} in the range of 30 to 90 minutes and found that the value of E_{cap}^* did not experience any significant changes. The results of the corresponding simulations are shown on the Fig. 5. The amount of time ahead a schedule is set does

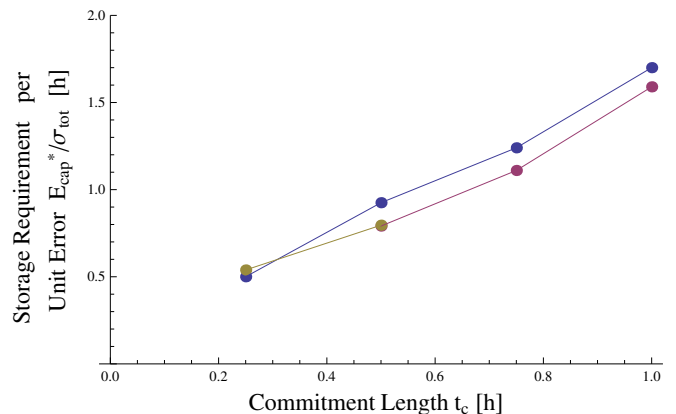


FIGURE 5. THE STORAGE COMMITMENT PER UNIT ERROR (SLOPE OF FIG. 4 FOR 1 HOUR) SCALED LINEARLY WITH t_C . THE DIFFERENT COLORS SHOW $T_{LA} = 30, 60, 90$ MIN.

not change storage requirements per unit of error when that forecast is made. As long as the forecast of the generation at t_{LA} is a good representation of the wind, generation can be scheduled far in advance. The effect of t_{LA} is indirect: simulations with larger t_{LA} have larger σ_{err} and thus require higher E_{cap}^* . However, σ_{err} , not t_{LA} is the value required to size storage in Eqn. (12).

Charging Rate

The power rating of a storage device, represented by the parameter P_{cap} , determines the maximum charging and discharging powers, $P_c(t)$ and $P_d(t)$, of a storage system. This value can represent either the actual technological limits associated with the storage system or the transmission capacity of the power grid interconnection of the wind farm and storage device.

To size power rating independently of the storage capacity, we set $E_{cap} = E_{cap}^*$ and impose P_{cap} constraints to find the effect of the power capacity on the the RMS mismatch between the power schedule and delivery. In Fig. 3, which plots the storage power rating vs. RMS error, we see the same fast decay followed by constant performance as observed for the capacity vs RMS plots in the previous section. The RMS value decays nearly to zero at $P_{cap} = P_{cap}^*$. By simulating datasets from different years and generating a family of results similar to those in Fig. 3, we find that P_{cap}^* scales as:

$$P_{cap}^* = \frac{E_{cap}^*(\sigma_{wind})}{t_D} = \frac{1.6t_C \sigma_{wind}}{t_D}, \quad (13)$$

where, t_D is the delivery time, set to 15 minutes for all the simulations. The value of P_{cap}^* does not depend on the forecast error σ_{err} . In order to completely remove the mismatch between the

committed and delivered power, the ESS is only mitigating the natural variability of the wind during a delivery interval. Therefore, the quality of the forecast does not affect the sizing of storage charging rate.

Analysis

For all simulations, the storage capacity vs RMS had the same shape, a sharp decrease followed by a steady asymptote. This shape means there are no benefits for oversizing storage for a wind generator. Oversizing storage will increase the cost of the storage system. Therefore, the value of a wind generation forecast is the cost savings for correctly sizing the minimum requirements for the storage system.

Value of forecast

A good forecast of available wind power will necessitate a smaller amount of storage to compensate for prediction errors. However, because of the natural variability of wind, storage is required even if the forecast is perfect if a constant power output is desired.

Nature of forecast Forecasts must be unbiased so they do not over or under predict wind. All of the forecast models considered were unbiased when all time intervals were considered. However, the persistence forecasts created biased predictions of the wind on individual intervals. The persistence model only considered what had previously happened, so on some intervals, the future generation was sometimes entirely over or under predicted. Since this forecast consistently produced wind predictions that were very different from the actual behavior of the wind, generation was poorly scheduled and storage was often completely drained or filled.

The Gaussian model of forecast error produced forecasts that well represented the future wind, however, the Gaussian noise did increase the variability of the wind time series. This model was unbiased at each interval, and the wind delivery was scheduled with some knowledge of future wind production. Wind forecasts must be able to estimate how long constant wind conditions might last or when changes in speed may occur. Forecasts cannot simply use persistence models to predict future generation, instead, they will have to use meteorological data to form forecasts that are meaningful. Relying only on the statistical properties of the wind or its history to form persistence forecasts is not sufficient to form a forecast to schedule a sequence of energy deliveries.

Forecast Error Considering only the Gaussian model of wind error, we measure the value of a forecast in terms of the amount of storage required to compensate for the RMS mismatch

between scheduled and delivered power. Storage capacity requirements were shown to scale linearly with the amount of total wind error, seen in Fig. 4. The dependence of the storage capacity on the statistical properties of the wind and forecast errors and scheduling timescales is given by Eqn. (12). The total storage requirement depends on the two components of wind deviations from a constant output, the natural variability of the wind and the prediction error at t_{LA} minutes in the future. The relationship between σ_{tot} , σ_{err} , and σ_{wind} means that there are diminishing returns of having a forecast with an error less than the variability of the wind within the commitment interval. With forecast errors much larger than the natural variability of the wind, the required storage resource scales linearly with the forecast error. Forecast error does not affect the storage ramping rate, so the cost of power capacity of storage is independent forecasting quality.

Conclusion

Using historical wind data and extensive simulation of MPC control of energy storage, we have demonstrated that intermittency of wind generation can be effectively mitigated by reasonably small amounts of storage. Our main finding can be summarized as follows:

The mismatch between the committed and delivered energy can be reduced to nearly zero provided the energy capacity exceeds critical value E_{cap}^* and the power rating of the storage system is larger than the critical value P_{cap}^* .

Critical values of energy capacity E_{cap}^* and power rating P_{cap}^* and can be accurately approximated by simple expressions Eqn. (12) and Eqn. (13), relating them to the natural variability of the wind, σ_{wind} , forecast error, σ_{err} , the commitment time period duration, t_C , and the delivery time, t_D .

The critical amount of storage E_{cap}^* required to make the wind power nearly dispatchable is relatively small and corresponds to roughly storing 10 minutes of average power generation.

The accuracy of the forecast affects the critical storage sizing, E_{cap}^* , however, the benefit of reducing forecasting error becomes small when the error approaches the natural wind variability.

We believe that the expressions Eqns. (12) and (13) are nearly universal and should be applicable to a wide range of systems. These expressions, if confirmed by other numerical studies, can be used for fast high level assessments of possible wind storage integration schemes. These expressions provide guidance on how the sizing of storage, the forecast accuracy, and market and operation timing affects the requirements for ESS.

We have found that the forecast error significantly affects the required storage capacity in the situations where the forecast error is comparable or larger than the natural wind variability. Surprisingly we have also found that the necessary power rating

does not depend on the forecast accuracy and is fully determined by the commitment and dispatch period durations and natural variability of the wind.

Large investments in storage can be avoided if the commitment time is reduced. The downside of this change in the market structure would be higher ramping rates and more complex scheduling for other generators in the electric grid. The look-ahead time for scheduling did not affect our results directly, however, forecasts made further in advance do have larger errors. In real life situations, the look-ahead time will enter the expressions Eqns. (12) and (13) through the value of forecast error σ_{err} .

We have found that the most important characteristic of the forecast is correctly predicting the mean of the wind speed during wind power scheduling. The systems with forecast models that failed to predict the right average wind speed showed very poor performance in our experiments even if the forecasted wind variance was more consistent with historical values.

REFERENCES

- [1] Lu, X., McElroy, M. B., and Kiviluoma, J., 2009. "Global potential for wind-generated electricity". *Proceedings of the National Academy of Sciences*, **106**(27), July, pp. 10933–10938.
- [2] Lindenberg, S., Smith, B., and ODell, K., 2008. "20% wind energy by 2030". *National Renewable Energy Laboratory (NREL), US Department of Energy, Renewable Energy consulting Services, Energetics Incorporated*.
- [3] Divya, K., and stergaard, J., 2009. "Battery energy storage technology for power systemsAn overview". *Electric Power Systems Research*, **79**(4), Apr., pp. 511–520.
- [4] Hadjipaschalis, I., Poullikkas, A., and Efthimiou, V., 2009. "Overview of current and future energy storage technologies for electric power applications". *Renewable and Sustainable Energy Reviews*, **13**(67), Aug., pp. 1513–1522.
- [5] Denholm, P., Ela, E., Kirby, B., and Milligan, M., 2010. The role of energy storage with renewable electricity generation. Tech. Rep. TP-6A2-47187, National Renewable Energy Laboratory.
- [6] Bathurst, G., and Strbac, G., 2003. "Value of combining energy storage and wind in short-term energy and balancing markets". *Electric Power Systems Research*, **67**(1), Oct., pp. 1–8.
- [7] Bouffard, F., and Galiana, F., 2008. "Stochastic security for operations planning with significant wind power generation". In 2008 IEEE Power and Energy Society General Meeting - Conversion and Delivery of Electrical Energy in the 21st Century, pp. 1–11.
- [8] Pinson, P., Papaefthymiou, G., Klockl, B., and Verboomen, J., 2009. "Dynamic sizing of energy storage for hedging wind power forecast uncertainty". In IEEE Power Energy Society General Meeting, 2009. PES '09, pp. 1–8.
- [9] Bludszuweit, H., and Dominguez-Navarro, J., 2011. "A probabilistic method for energy storage sizing based on wind power forecast uncertainty". *IEEE Transactions on Power Systems*, **26**(3), Aug., pp. 1651–1658.
- [10] NERC, 2010. Response to interchange authority, standard INT-006-3.
- [11] BPA data. <http://transmission.bpa.gov/business/operations/wind/>.

ACKNOWLEDGMENT

We thank Misha Chertkov and other participants of Los Alamos National Laboratory smart grid seminar series for feedback on the preliminary results of our studies. Our work has been partially supported by NSF award ECCS - 1128437, MIT/SkTech and MISTI seed grants and LANL subcontract (KT and CJ).